


PLAN VIEW

1"x1" CHAMFER (TYP.)  
 \*\*ALL EXPOSED EDGES

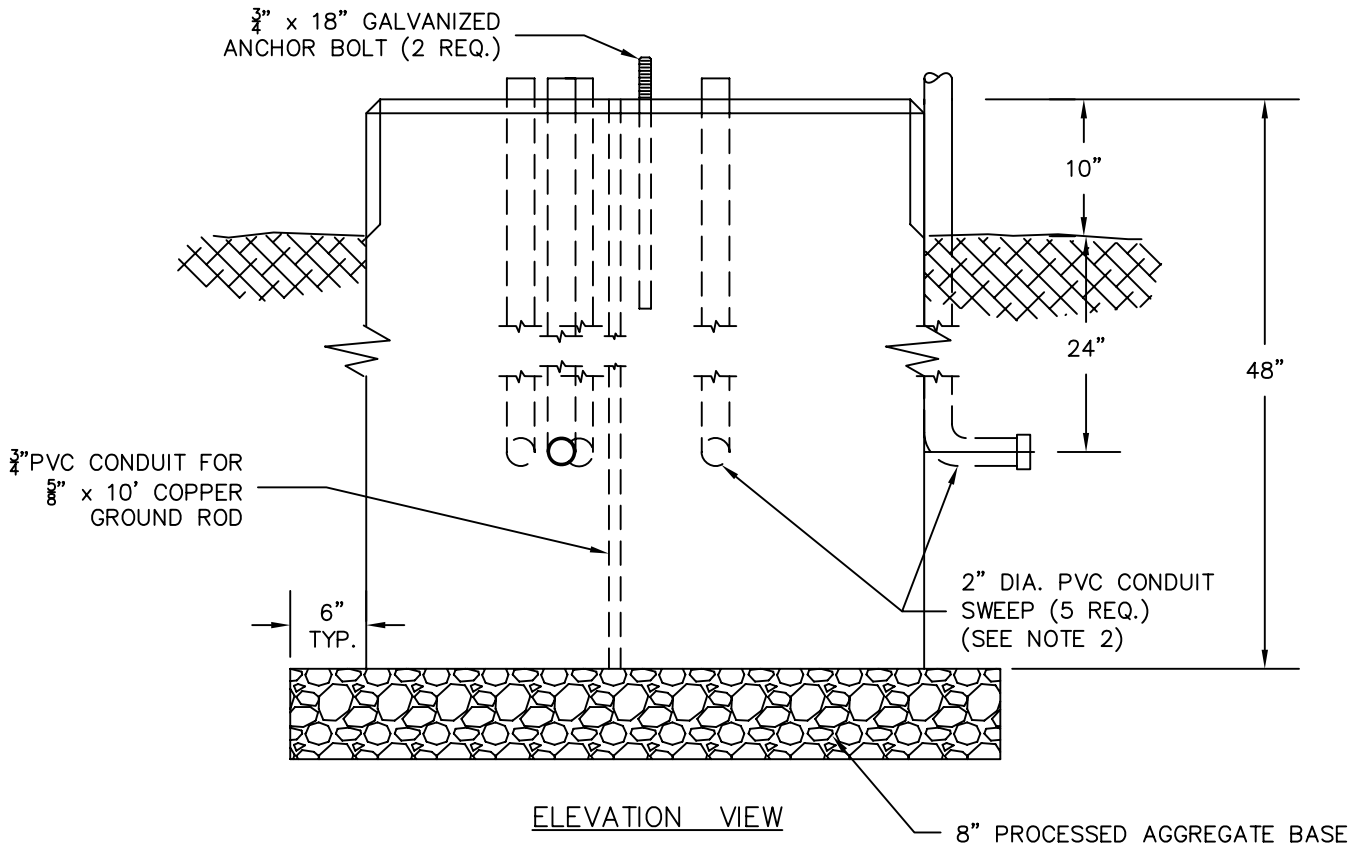

ELEVATION VIEW

8" PROCESSED AGGREGATE BASE

NOTES:

1. FOUNDATION SHALL BE OF CLASS "C" CONCRETE, AND MAY BE PRECAST.
2. ONE (1) SWEEP SHALL BE ON THE EXTERIOR AND DEDICATED FOR THE UTILITY CO. POWER FEED.
3. ALL SWEEPS SHALL BE 2" DIA. P.V.C. CONDUIT.



TOWN OF WINDSOR  
 Engineering Department



STREET LIGHT CONTROLLER  
 FOUNDATION

D-404



SCALE: HOR. NTS \_\_\_\_\_ DATE: MAY 2010  
 VER. \_\_\_\_\_